



BE Series Electric Boiler

15# Steam Design

30 kw to 390 kw

EFFECTIVE DATE: 2-22-22
REPLACED DATE: 3-1-04

- NOTES:
1. DIMENSIONS ARE SUBJECT TO CHANGE WITHOUT NOTICE. CONSULT FACTORY FOR CERTIFIED DIMENSIONS.
2. TIE IN OF EXPANSION TANK CONNECTION IS ESSENTIAL TO INSURE PROPER OPERATION OF THE LOW WATER CUT-OFF FLOAT.
3. NOT INTENDED FOR USE AS A PRINCIPAL HEATING SOURCE FOR LIVING SPACE OF AN INDIVIDUAL RESIDENCE.

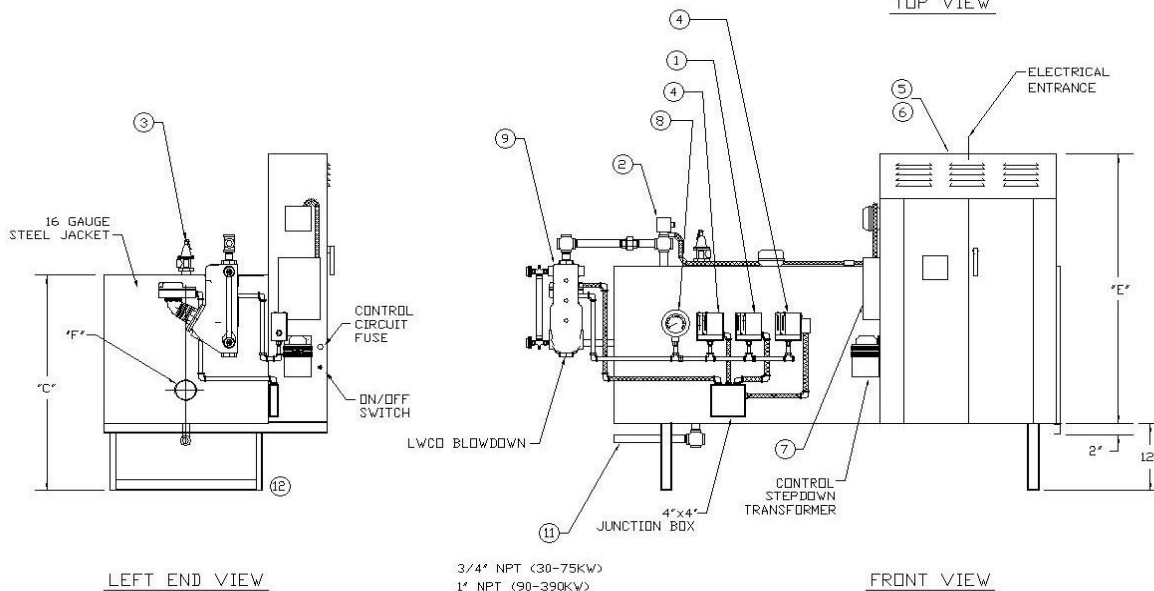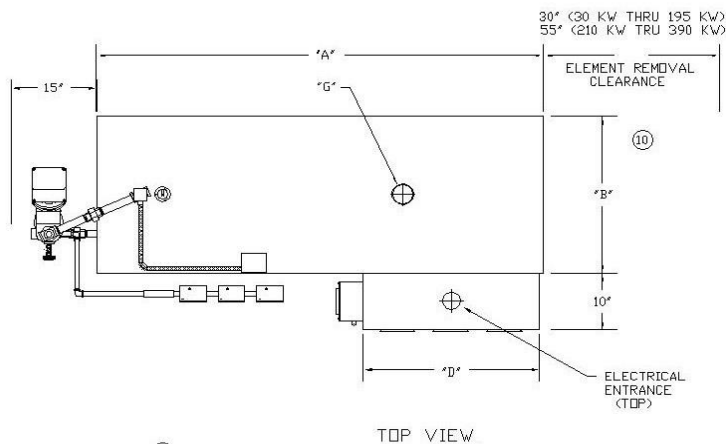

- | | | |
|--------------------|--------------------|---------------------------|
| 1. OPERATOR | 5. POWER PANEL | 9. LWCO/PUMP CONTROLLER |
| 2. PROBE TYPE LWCO | 6. CONTROL PANEL | 10. ELEMENT ACCESS |
| 3. RELIEF VALVE | 7. STEP CONTROLLER | 11. BOTTOM BLOW DOWN |
| 4. PRESSURETROL | 8. PRESSURE GAUGE | 12. STRUCTURAL STEEL LEGS |

	BES Series										Fluid Cap. Oper. Level Gallons		Aprox. Ship WT.
	Vessel Dimensions			Power Panel Voltage				Inlet	Outlet				
	length	width	height	208-230/3/60		380-460-575/3/60							
	A	B	C	D	E	D	E	F	G	Water	Steam		
KW	48	20	32	20	30	20	30	2	2	24	13	775	
30	48	20	32	20	30	20	30	2	2	24	13	775	
45	48	20	32	30	36	20	36	2	2	24	13	775	
60	48	20	32	30	36	20	36	2	2	24	13	850	
75	48	20	32	30	36	20	36	2	2	24	13	1000	
90	48	28	40	30	36	20	36	3	3	52	32	1025	
105	48	28	40	30	48	30	48	3	3	52	32	1050	
120	48	28	40	30	48	30	48	3	3	52	32	1300	
135	48	28	40	30	48	30	48	3	3	52	32	1325	
150	48	28	40	30	48	30	48	3	3	52	32	1350	
165	48	28	40	30	48	30	48	3	3	52	32	1400	
180	48	28	40	30	48	30	48	3	3	52	32	1450	
195	48	28	40	30	66	30	66	3	3	52	32	1950	
210	76	28	40	C/F	C/F	30	66	3	3	105	69	2000	
240	76	28	40	C/F	C/F	30	66	3	3	105	69	2450	
270	76	28	40	C/F	C/F	30	66	3	3	105	69	2500	
300	76	28	40	C/F	C/F	36	66	3	3	105	69	2550	
330	76	28	40	C/F	C/F	36	66	3	3	105	69	2600	
360	76	28	40	C/F	C/F	36	72	3	3	105	69	2650	
390	76	28	40	C/F	C/F	36	72	3	3	105	69		



BRYAN BOILERS LLC

783 NORTH CHILI AVE
PERU, INDIANA 46970

FORM NO.:

2246